



Translation of Test Certificate No.7452347792
Issued under Section 12 of the Standards Law, 1953

Details of order

Applicant : DEKRA Testing and Certification (Shanghai) Ltd.
Address : Block 5, NO.3, Qiyun Road Huangpu District, Guangzhou, Guangdong, China.
Date of order: 08/07/2024

Description of product

Fixed socket-outlet
Model tested: EK-PWS-IL Description: socket-outlet with an earthing contact
Manufacturer: EKINEX S.P.A
Country of manufacture: Italy
(For additional details, see detailed product description.)

Sampling details

The sample was taken on: 08/07/2024 The Sampler: By the applicant.
Sample size: 3

Nature of test

1. Compliance with the requirements of clauses: 8-Marking, 9-Checking of dimensions, 10-Protection against electric shock of the Israeli Standard SI 32 part 1.1 - Plugs and socket outlets for household and similar purposes: Plugs and socket-outlets for single phase up to 16A – General requirements from September 2017, Amendment No. 1 from March 2020.
2. Verification of CB Certificate No. NL-111064 issued by DEKRA Certification B.V., Netherlands, dated 23/09/2024 and of CB Test Report No.4914430.52, issued by DEKRA Testing and Certification (Shanghai) Ltd., Guangzhou branch, 23/09/2024.

This document contains 4 pages and may be used only in full.

The test results in this document refer only to the item tested.

This document is not a Standards Mark license

Conclusions

The product complies with the requirements of the Israeli Standard according to the tests in nature of test and by verification of CB test certificate and report mentioned above.


Test results are detailed in the inside pages of this document.

The original Test Certificate was signed by:

Name: Bilal Halluma Position: Test Engineer Date: 2024-10-28

I confirm that this is a true translation of the Hebrew original. Only the original test certificate is authentic.

Name: Itzhak Aleme Position: Head of Installation Devices Section Date: 2024-10-30

Signature: 



Translation of Test Certificate No. 7452347792

Issued under Section 12 of the Standards Law, 1953

Page 2 of 4 pages

Broadened description of the product

The product submitted for testing is a fixed socket-out let with an earthing contact, for recessed installation in a round box.

The socket out-let is equipped with shutters that cover the current-carrying contacts.

The white plastic cover fixed to the base by one metal screw and the nickel cover fixed by black adapter.

The socket is made of insulating material and current-carrying parts are of metal.

Critical components are listed on page 6 of Report No. 4914430.52

Marking:

The marking on the socket base:

ekinex EK-PWS-IL

~16A 250V

made in PRC CE

The marking on the metal cover and its packaging:

ekinex 1066

Deep square plate-Nickel

EK-DQG-GBR

Made in Italy

The marking on the adaptor and its packaging:

ekinex 1099

Adapter for square plate



EK-TAQE-1-NF

Translation of Test Certificate No. 7452347792

Issued under Section 12 of the Standards Law, 1953

Page 3 of 4 pages

The product images

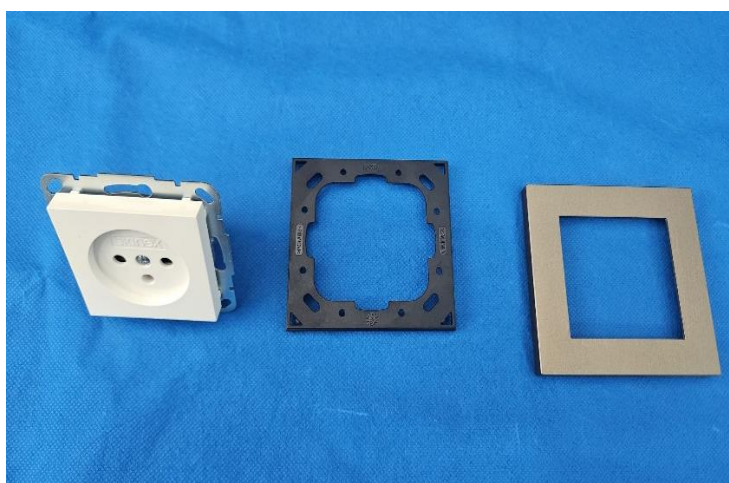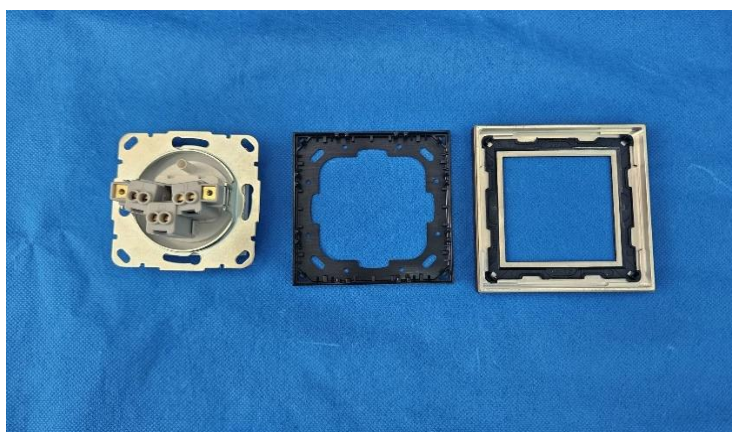

Translation of Test Certificate No. 7452347792

Issued under Section 12 of the Standards Law, 1953

Page 4 of 4 pages

Clause no.	Description of clause	Defects	Conclusion
8	Marking		Complies
9	Checking of dimensions		Complies
10	Protection against electric shock		Complies

————— **End of Test Certificate** —————